

1. ALL WATER TANK FROM 3 TO 8 M³ INH - WITH BUILT-IN PRE-FILTER POLYETHYLENE (PE)

6004

GARANTIE
CONTRE LA
CORROSION
JUSQU'À

20 ANS



3 M3 ALL-WATER TANK



4 AND 5 M3 ALL-WATER TANK



6 AND 8 M3 ALL-WATER TANKS



WASTEWATER TREATMENT

1 Technical definition

An all-water tank is a pre-treatment structure designed to retain settleable matter present in domestic wastewater from a dwelling. Domestic wastewater includes black water (WC, etc.) and grey water (bathroom, kitchen, laundry). A complete wastewater treatment system consists of an all-water tank and an ancillary treatment system (sand filter, spreading network, ZEOMOP or BIONUT compact filter).

The pre-filter integrated into the all-water tank is located at the outlet. Reliable and safe, it prevents premature clogging of the downstream treatment system (sand filter, sewage system, etc.) by retaining unsettled particles. It is easy to handle and maintain. To avoid any risk of floatation during maintenance visits, the system automatically closes the outlet to the downstream treatment system.



2 Maintenance

The capacities of the SIMOP all-water pits take into account 2 criteria:

- Sludge storage volume
- the admissible flow rate

These criteria have enabled SIMOP to characterize the type of tank adapted to the need according to the permanent or non-permanent use of the grouped habitat. On the basis of 150 liters of water consumed per day and per inhabitant, our all-water pits can be used according to table 01.

3 Ventilation

No ventilation tapping is provided on the tank. Primary and secondary ventilation must be provided respectively upstream and downstream of the tank (cf. standard XP P16-603, ex NF DTU 64.1, available from AFNOR).

4 Installation

- Please refer to the PHPE installation instructions before handling and installing the tank.
- Maximum backfill height above tank = 30 cm.

5 Sizing

The interministerial decree of 07/03/12 modified by the decree of 7/03/2012 stipulates the following minimum dimensions:

No. of parts main	Minimum useful volume	SIMOP references
5	3 m ³	FTE2/6004/03
6	4 m ³	FTE2/6004/04
7	5 m ³	FTE2/6004/05
8	6 m ³	INH06000
10	8 m ³	INH08000

6 Advice

To reduce the proliferation of mosquitoes in the system, the effluent must not be accessible from the outside, therefore :

- close all lids tightly,
- check and clean the insect screens on the outside air intake caps regularly,
- ensure that the secondary ventilation outlet is equipped with a mosquito screen or odor filter.


1. ALL WATER TANK

FROM 3 TO 8 M³

INH - WITH BUILT-IN PRE-FILTER

POLYETHYLENE (PE)

6004

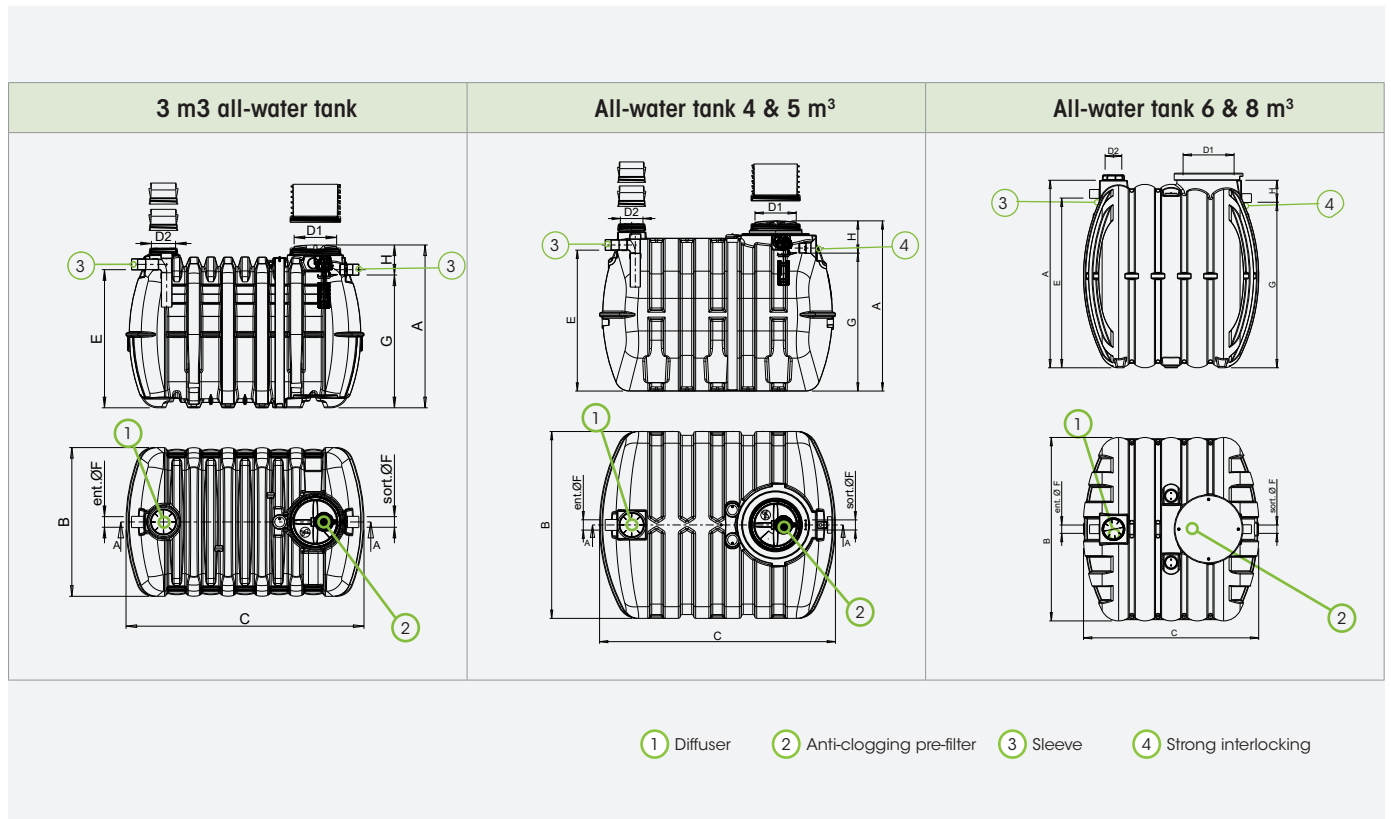

WASTEWATER TREATMENT

References	Vol. in l	A	B	C	Ø D1	Ø D2	E	F	G	H	Weight in kg	Max. back-fill height (mm)
FTE2/6004/03	3 000	1 533	1 400	2 240	Ø 400	Ø 200	1 300	Ø 100	1 250	283	102	300
FTE2/6004/04	4 000	1 649	1 810	2 287	Ø 400	Ø 200	1 365	Ø 100	1 335	314	127	300
FTE2/6004/05	5 000	1 799	1 977	2 390	Ø 400	Ø 200	1 500	Ø 100	1 470	329	175	300
INH06000	6 000	2 250	2 200	2 100	Ø 600	Ø 200	2 040	Ø 160	1 990	260	225	300
INH08000	8 000	2 250	2 200	2 720	Ø 600	Ø 200	2 040	Ø 160	1 990	260	359	300

PE	FTE reference	RH2/4031 Ø x height 300	RH2/6030 Ø x height 300	RH2/03/15 Ø x height 150
4 EH	FTE2/6004/03	X		X
5 EH	FTE2/6004/04	X		
6 EH	FTE2/6004/05	X		
8 EH	INH06000		X	
10 EH	INH08000		X	